



SEIL P1/APPCB/BZA/2022/010
27th December 2022

Sembcorp Energy India Limited
CIN: U40103TG2008PLC057031
Regd. Office: 5th Floor, Tower C, Building No 8
DLF Cybercity, Gurgaon - 122002, Haryana, India
Tel (91) 124 389 6700 / 01
Fax (91) 124 389 6710
E-mail: cs.india@sembcorp.com
Website: www.sembcorpenergyindia.com

To
The Member Secretary,
Andhra Pradesh Pollution Control Board,
D. No. 33-26-14 D/2, Near Sunrise Hospital,
Pushpa Hotel Centre, Chalamalavari Street,
Kasturibaipet,
Vijayawada- 520010.

Sub: Submission of Half Yearly CFO Compliance Report of SEIL Project-1 (formerly known as Thermal Powertech Corporation India Limited) for the period April 2022 to September 2022

Ref: CFO issued vide order: APPCB/VJA/NLR/930/HO/CFO/2016 dated 16th November 2021, valid till 30.11.2026.


Dear Sir,

This has reference to the above subject, we here by submit the Half Yearly compliance report for the period from April 2022 to September 2022 against the conditions stipulated under CFO issued to SEIL Project-1 (Formerly known as Thermal Powertech Corporation India Limited), Nellore.

Hope the above is in order.

Thanking you,


Yours faithfully,
For **M/s. Sembcorp Energy India Limited,**


Pavan Kumar Rao V
Head HSE - SEIL

Copy To: The Regional Officer, APPCB, Nellore

*M/s. Sembcorp Energy India Limited Project-1,
Painampuram & Nelaturu (V),
Muthukur (M),
SPSR Nellore (Dist.)*

Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

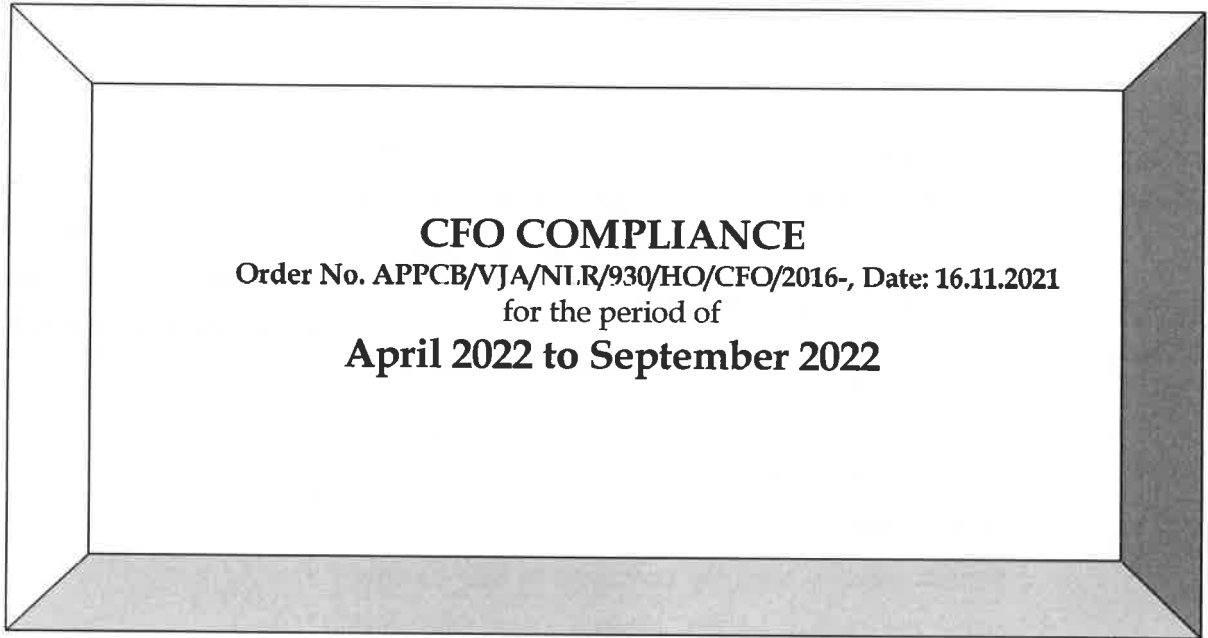

Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

Compliance against CFO Conditions		
S. No	Condition	Compliance Status
SCHEDULE-A		
1.	Any up-set condition in any industrial plant/ activity of the industry, which result in, increased effluent/ emission discharge and / or violation of standards stipulated in this order shall be informed to this Board, under intimation to the Collector and District Magistrate and take immediate action to bring down the discharge/emission below the limits.	Complying, being done proactively.
2.	The industry shall carryout analysis of waste water discharges or emissions through chimneys for the parameters mentioned in this order on quarterly basis and submit to the Board.	Complying. Environment Monitoring Reports conducted by MoEF&CC approved third party are attached as Annexure-I, II, III & IV
3.	All the rules & Regulations notified by Ministry of Law and Justice, Government of India regarding Public liability Insurance Act, 1991 shall be followed as applicable.	Complying. A Copy of PLI is attached as Annexure-V
4.	Notwithstanding anything contained in this consent order the Board hereby reserves the right and powers to review/ revoke any and /or all the conditions imposed herein above and to make such variations as deemed fit for the purpose of the Acts by the Board.	Noted.
5.	The industry shall ensure that there shall not be any change in the process technology, source & composition of raw materials and scope of working without prior approval from the Board.	Noted.
6.	The applicant shall submit Environment Statement in Form V before 30 th September every year as per Rule no.14 of E(P) Rules 1986 & amendments thereof.	Complying. Environment Statement (Form-V) has been submitted for FY 2021-22.




Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status
7.	The applicant should make applications through Online for renewal of Consent (Under Water and Air Acts) and Authorization under HWM Rules at least 120 days before the date of expiry of this order, along with prescribed fee under Water and Air Acts and detailed compliance of CFO conditions for obtaining Consent & HW Authorization of the Board.	Noted for Compliance.
8.	The industry shall immediately submit the revised application for consent to this Board in the event of any change in the raw material use, process employed, quantity of trade effluents & Quantity of emissions. Any change in the management shall be informed to the Board. The person authorize shall not let out the premises /lend/sell/transfer their industrial premises without obtaining prior permission of the State Pollution Control Board	Noted for Compliance.
9.	Any person aggrieved by an order made by the State Board under Section 25, Section 26, Section 27 of water Act, 1974 or Section 21 of Air Act, 1981 may within thirty days from the date on which the order is communicated to him, prefer an appeal as per Andhra Pradesh Water Rules, 1976 and Air Rules 1982 to Appellate authority constituted under Section 28 of the Water(Prevention and Control of Pollution) Act, 1974 and Section 31 of the Air (Prevention and Control of Pollution) Act 1981.	Noted.



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

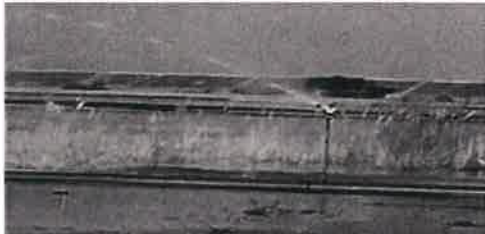S. No	Condition	Compliance Status
10.	The industry shall be liable to pay Environmental Compensation / Other Environmental Taxes, if any environmental damage caused to the surroundings, as fixed by the Collector & District Magistrate or any other component authority as per the Rules in vogue.	Noted.
11.	The industry may explore the possibility of tapping the solar energy for their energy requirements.	Noted for Compliance. SEIL P-1 has installed roof top solar panels and solar streetlights. SEIL is also exploring the suitability for small capacity solar plant.
12.	The industry should educate the workers and nearby public of possible accidents and remedial measures.	Complying. Regular trainings are being given to workers. All the measures have been taken to avoid any mishap which may lead to harm outside the plant premises (Off site)
SCHEDULE-B		
Special Conditions		
S. No	Condition	Compliance Status
1.	The industry shall provide FGD system to meet the SO ₂ emission standards of 200 mg/Nm ³ by 31.12.2024, as per MoEF&CC, GoI notification GSR No.243 (E), dt.31.03.2021.	SEIL is committed to commission Flue Gas Desulfurization System (FGD) to meet the SO _x limits as per the latest Notifications/Directions issued.
2.	The industry shall maintain water sprinklers around the ash pond area to control fugitive emissions in the surrounding area within 2 months and report compliance to RO, Nellore.	Complied. SEIL has provided rotating water sprinklers around the ash pond to prevent fugitive emission. Consistent efforts being ensured to keep Pond Ash moist with thin layer of water above the surface. 




Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status																																															
Water Pollution																																																	
3.	<p>The industry shall comply with the following effluent standards based on the disposal points permitted:</p> <table border="1"> <thead> <tr> <th>Outlet</th> <th>Parameter</th> <th>Limiting standards</th> </tr> </thead> <tbody> <tr> <td rowspan="11">1to3</td> <td>pH</td> <td>6.5 to 8.5</td> </tr> <tr> <td>Suspended solids</td> <td>100 mg/l</td> </tr> <tr> <td>Oil & Grease</td> <td>10 mg/l</td> </tr> <tr> <td>Temperature</td> <td>Shall not exceeded 5° C above the receiving water temperature</td> </tr> <tr> <td>Biochemical oxygen demand (3 days at 27°C)</td> <td>100 mg/l</td> </tr> <tr> <td>Chemical Oxygen Demand (COD)</td> <td>250 mg/l</td> </tr> <tr> <td>Arsenic</td> <td>0.2 mg/l</td> </tr> <tr> <td>Mercury</td> <td>0.01 mg/l</td> </tr> <tr> <td>Lead</td> <td>2.0 mg/l</td> </tr> <tr> <td>Cadmium</td> <td>2.0 mg/l</td> </tr> <tr> <td>Hexavalent Chromium</td> <td>1.0 mg/l</td> </tr> <tr> <td rowspan="11">5 to 8</td> <td>Bio-assay test</td> <td>90% survival fish after 96 hours in 100% effluents</td> </tr> <tr> <td>pH</td> <td>5.5 - 9.0</td> </tr> <tr> <td>Suspended solids</td> <td>100 mg/l</td> </tr> <tr> <td>Oil & Grease</td> <td>10 mg/l</td> </tr> <tr> <td>Biochemical oxygen demand (3 days at 27°C)</td> <td>100 mg/l</td> </tr> <tr> <td>Arsenic (as As)</td> <td>0.2 mg/l</td> </tr> <tr> <td>Cyanide (as CN)</td> <td>0.2 mg/l</td> </tr> <tr> <td>Bio-assay test</td> <td>90% survival fish after 96 hours in 100% effluents</td> </tr> <tr> <td>Copper (Total)</td> <td>1 mg/l</td> </tr> <tr> <td>Iron (Total)</td> <td>1 mg/l</td> </tr> </tbody> </table>	Outlet	Parameter	Limiting standards	1to3	pH	6.5 to 8.5	Suspended solids	100 mg/l	Oil & Grease	10 mg/l	Temperature	Shall not exceeded 5° C above the receiving water temperature	Biochemical oxygen demand (3 days at 27°C)	100 mg/l	Chemical Oxygen Demand (COD)	250 mg/l	Arsenic	0.2 mg/l	Mercury	0.01 mg/l	Lead	2.0 mg/l	Cadmium	2.0 mg/l	Hexavalent Chromium	1.0 mg/l	5 to 8	Bio-assay test	90% survival fish after 96 hours in 100% effluents	pH	5.5 - 9.0	Suspended solids	100 mg/l	Oil & Grease	10 mg/l	Biochemical oxygen demand (3 days at 27°C)	100 mg/l	Arsenic (as As)	0.2 mg/l	Cyanide (as CN)	0.2 mg/l	Bio-assay test	90% survival fish after 96 hours in 100% effluents	Copper (Total)	1 mg/l	Iron (Total)	1 mg/l	<p>Complying.</p> <p>Effluent Quality Monitoring Reports performed by MoEF&CC approved third Party consultant are attached as Annexure-I.</p>
Outlet	Parameter	Limiting standards																																															
1to3	pH	6.5 to 8.5																																															
	Suspended solids	100 mg/l																																															
	Oil & Grease	10 mg/l																																															
	Temperature	Shall not exceeded 5° C above the receiving water temperature																																															
	Biochemical oxygen demand (3 days at 27°C)	100 mg/l																																															
	Chemical Oxygen Demand (COD)	250 mg/l																																															
	Arsenic	0.2 mg/l																																															
	Mercury	0.01 mg/l																																															
	Lead	2.0 mg/l																																															
	Cadmium	2.0 mg/l																																															
	Hexavalent Chromium	1.0 mg/l																																															
5 to 8	Bio-assay test	90% survival fish after 96 hours in 100% effluents																																															
	pH	5.5 - 9.0																																															
	Suspended solids	100 mg/l																																															
	Oil & Grease	10 mg/l																																															
	Biochemical oxygen demand (3 days at 27°C)	100 mg/l																																															
	Arsenic (as As)	0.2 mg/l																																															
	Cyanide (as CN)	0.2 mg/l																																															
	Bio-assay test	90% survival fish after 96 hours in 100% effluents																																															
	Copper (Total)	1 mg/l																																															
	Iron (Total)	1 mg/l																																															
	4.	<p>The source of water is sea. The following is the permitted water consumption:</p> <table border="1"> <thead> <tr> <th>S. No</th> <th>Purpose</th> <th>Quantity in KLD (for 2X660 MW)</th> </tr> </thead> <tbody> <tr> <td>1.</td> <td>For cooling tower make up (saline water)</td> <td>1,98,256</td> </tr> <tr> <td rowspan="7">2.</td> <td>Non-cooling water - RO First pass</td> <td></td> </tr> <tr> <td>i) Ash handling sealing</td> <td>2240</td> </tr> <tr> <td>ii) Coal handling plant dust suppression</td> <td>4768</td> </tr> <tr> <td>iii) High Vacuum AC make up</td> <td>1660</td> </tr> <tr> <td>iv) Misc. services (for firefighting etc.)</td> <td>512</td> </tr> <tr> <td>v) RO Reject</td> <td>22224</td> </tr> <tr> <td>vi) Clarifier blow down</td> <td>1056</td> </tr> <tr> <td></td> <td>RO Second pass</td> <td></td> </tr> <tr> <td></td> <td>i. DM Plant</td> <td>2080</td> </tr> <tr> <td></td> <td>ii. Domestic (Plant)</td> <td>50</td> </tr> <tr> <td></td> <td>Total</td> <td>2,32,846</td> </tr> </tbody> </table>	S. No	Purpose	Quantity in KLD (for 2X660 MW)	1.	For cooling tower make up (saline water)	1,98,256	2.	Non-cooling water - RO First pass		i) Ash handling sealing	2240	ii) Coal handling plant dust suppression	4768	iii) High Vacuum AC make up	1660	iv) Misc. services (for firefighting etc.)	512	v) RO Reject	22224	vi) Clarifier blow down	1056		RO Second pass			i. DM Plant	2080		ii. Domestic (Plant)	50		Total	2,32,846	<p>Complying.</p> <p>The average seawater with drawl during April 2022 to September 2022 is well within permissible limits.</p>													
S. No	Purpose	Quantity in KLD (for 2X660 MW)																																															
1.	For cooling tower make up (saline water)	1,98,256																																															
2.	Non-cooling water - RO First pass																																																
	i) Ash handling sealing	2240																																															
	ii) Coal handling plant dust suppression	4768																																															
	iii) High Vacuum AC make up	1660																																															
	iv) Misc. services (for firefighting etc.)	512																																															
	v) RO Reject	22224																																															
	vi) Clarifier blow down	1056																																															
	RO Second pass																																																
	i. DM Plant	2080																																															
	ii. Domestic (Plant)	50																																															
	Total	2,32,846																																															



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status
5.	The industry shall maintain separate digital water meters in the intake point of sea water (i.e. at sea coast) with totalizer facility unit wise to assess daily water consumption quantity instead of cumulative water consumptions.	Complying. Separate digital water meters with totalizer facility are provided for Cooling Tower make-up and Desalination system. Monthly totalizer readings are being captured jointly along with Port Conservator, Govt. of India in a separate log book.
6.	The industry shall maintain flow meter preferably Electro Magnetic Flow meters with totalizers for water and effluent quantity measurements for different streams of effluents and different categories of water usage stipulated in this order.	Complying. SEIL has provided separate flow meters with totalizers for quantity measurement: <ul style="list-style-type: none"> ↓ Cooling Tower Makeup ↓ Desalination water ↓ Cooling Tower blowdown ↓ RO Reject water ↓ ETP outlet
7.	The industry shall provide leachate collection tank to collect the leachate from garland drain of ash pond.	Complying. The Ash Pond is provided with garland drains all around to collect leachates, if any. Separate Leachate collection tank connected to all the garland drains of Ash Pond. 



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status						
8.	The industry shall maintain provision to collect the excess water from the ash pond into sea to control overflow of saline water from ash pond and to prevent irrigation tanks being polluted.	Complying. SEIL has ensured adequate provision at ash pond having an overflow lagoon connected to decantation well of both lagoons and the water is recirculated back to ash handling system for reuse.						
Air Pollution:								
9.	<p>The emissions shall not contain constituents in excess of the prescribed limits mentioned below:</p> <table border="1"> <thead> <tr> <th>Chimney No</th> <th>Parameter</th> <th>Emission standards in mg/Nm³</th> </tr> </thead> <tbody> <tr> <td>1 - 2</td> <td>Particulate Matter</td> <td>50</td> </tr> </tbody> </table>	Chimney No	Parameter	Emission standards in mg/Nm ³	1 - 2	Particulate Matter	50	SEIL is Complying with the Emission norms of Particulate Matter. Stack Emission Monitoring reports are attached as Annexure-II.
Chimney No	Parameter	Emission standards in mg/Nm ³						
1 - 2	Particulate Matter	50						
10.	<p>The industry shall comply with ambient air quality standards of PM₁₀ (Particulate Matter size less than 10µm)-100 µg/m³; PM_{2.5} (Particulate Matter size less than 2.5 µm)- 60 µg/m³; SO₂- 80 µg/m³; NO_x- 80 µg/m³, outside the factory premises at the periphery of the industry.</p> <p>Standards for other parameters as mentioned in the National Ambient Air Quality Standards CPCB Notification No.B-29016/20/90/PCI-I, dated 18.11.2009.</p> <p>Noise Levels: Day time (6 AM to 10 PM) - 75 dB (A) Night time (10 PM to 6 AM) - 70 dB (A)</p>	<p>Complying.</p> <p>SEIL is complying with Ambient Air Quality parameters as prescribed in NAAQM Standards.</p> <p>Ambient Air Quality Monitoring reports and Noise Monitoring reports conducted by MoEF&CC approved third party consultant are attached as Annexure-III.</p>						





Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status												
11.	<p>The emissions shall not contain constituents in excess of the prescribed limits mentioned below:</p> <table border="1" data-bbox="336 562 930 741"> <thead> <tr> <th>Chimney No</th> <th>Parameter</th> <th>Emission standards</th> </tr> </thead> <tbody> <tr> <td rowspan="4">1&2</td> <td>Particulate Matter</td> <td>50 mg/Nm³</td> </tr> <tr> <td>Sulphur Dioxide</td> <td>*200 mg/Nm³</td> </tr> <tr> <td>Oxides of Nitrogen</td> <td>*450 mg/Nm³</td> </tr> <tr> <td>Mercury (Hg)</td> <td>*0.03 mg/Nm³</td> </tr> </tbody> </table> <p>*The industry shall meet the SO₂ emission standard of 200 mg/Nm³ by 31.12.2024, as per MoEF&CC , GoI notification GSR No. 243 (E), dt.31.03.2021.</p>	Chimney No	Parameter	Emission standards	1&2	Particulate Matter	50 mg/Nm ³	Sulphur Dioxide	*200 mg/Nm ³	Oxides of Nitrogen	*450 mg/Nm ³	Mercury (Hg)	*0.03 mg/Nm ³	<p>SEIL is Complying with the Emission norms of Particulate Matter, Oxides of Nitrogen and Mercury.</p> <p>Stack Emission Monitoring Reports performed by MoEF&CC approved third Party consultant are attached as Annexure-II.</p>
Chimney No	Parameter	Emission standards												
1&2	Particulate Matter	50 mg/Nm ³												
	Sulphur Dioxide	*200 mg/Nm ³												
	Oxides of Nitrogen	*450 mg/Nm ³												
	Mercury (Hg)	*0.03 mg/Nm ³												
12.	<p>The industry shall comply with emission limits for DG sets of capacity up to 800 KW as per the Notification G.S.R.520 (E), dated 01.07.2003 under the Environment (Protection) Amendment Rules, 2003 and G.S.R.448(E), dated 12.07.2004 under the Environment (Protection) Second Amendment Rules, 2004. In case of DG sets of capacity more than 800 KW shall comply with emission limits as per the Notification G.S.R.489 (E), dated 09.07.2002 at serial no.96, under the Environment (Protection) Act, 1986.</p>	<p>Complying.</p> <p>SEIL is complying with the applicable emission norms.</p> <p>DG stack Emissions is being monitored by MoEF&CC approved third party consultant and attached as Annexure-VI.</p>												





Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No	Condition	Compliance Status
13.	<p>The industry shall maintain wind barriers/ wind breaking walls to the coal yards as temporary arrangement to control fugitive dust emissions on immediate surroundings.</p>	<p>SEIL has provided wind barriers all around coal yard with 3-tier thick Conocarpus trees. SEIL has transplanted adequate matured plants around coal yard as per directions given in Task force committee meeting.</p>  <p>In addition, SEIL has installed adequate water sprinklers with water hydrant system in coal yard to mitigate fugitive emission.</p> 



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No.	Condition	Compliance Status
14.	<p>The industry shall regularly operate water sprinklers provided to control stock yard to mitigate fugitive dust on the surroundings from coal handling area.</p>	<p>Complying.</p> <p>SEIL has installed adequate water sprinklers in coal yard to mitigate fugitive emission. Water consumption on monthly basis is being submitted attached as Annexure-VII</p> 
15.	<p>The industry shall provide necessary air pollution control systems at coal transfer points in coal conveyer system from port boundary to industry premises within 3 months.</p>	<p>Complying.</p> <p>Entire coal transportation from port boundary to industry premises is through closed pipe conveyors. All the coal transfer points and coal crusher are provided with bag filter (Dust Extraction [DE] System).</p>  <p>DE system at Transfer points</p>



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. NO.	Condition	Compliance Status
16.	The industry shall upgrade the air pollution control systems at coal crusher within 3 months.	Complying. Coal crusher is provided with Dry Fog Dust Suppression System.
17.	The industry shall provide separate energy meters along with totalizer facility for each ESP.	Complying. SEIL has provided separate energy meters to monitor ESP Power Consumption.
18.	The industry shall comply with the MoEF&CC Notification S.O. 3305(E), dated 07.12.2015 and S.O. 682 (E), dated 07.03.2016 as applicable and report compliance to RO: Nellore.	Complying. SEIL is committed to commission Flue Gas Desulfurization System (FGD) to meet the SO _x limits as per the latest Notifications/Directions issued.




Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021



S. No.	Condition	Compliance Status
General		
19.	The industry shall handover the Original Consent Order dated 15.02.2016 to the RO: Nellore after receipt of this CFO order.	Complied.
20.	The industry shall maintain the following records and the same shall be made available to the inspecting officers of the Board: a. Daily production details (ER-1 Central Excise Returns). b. Quantity of Effluents generated, treated, recycled/ reused and disposed. c. Log Books for pollution control systems. d. Characteristics of effluents and emissions. e. Hazardous/Non-Hazardous solid waste generated and disposed. f. Inspection book. g. Manifest copies of hazardous.	Complying. All such applicable records are being regularly maintained.



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No.	Condition	Compliance Status												
21.	<p>The industry shall dispose solid waste (Non-Haz) as follows:</p> <table border="1" data-bbox="339 613 890 958"> <thead> <tr> <th>S. No.</th> <th>Name of the Solid Waste</th> <th>Quantity</th> <th>Disposal</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Fly Ash</td> <td>0.96 Million Tons/ Annum</td> <td>To Cement / brick units</td> </tr> <tr> <td>2</td> <td>Bottom Ash</td> <td>0.24 Million Tons/ Annum</td> <td>To cement, brick manufacturing units. Unutilized bottom ash to ash pond in slurry mode</td> </tr> </tbody> </table>	S. No.	Name of the Solid Waste	Quantity	Disposal	1	Fly Ash	0.96 Million Tons/ Annum	To Cement / brick units	2	Bottom Ash	0.24 Million Tons/ Annum	To cement, brick manufacturing units. Unutilized bottom ash to ash pond in slurry mode	<p>Complying.</p> <p>Fly ash is being collected in dry form and stored in silos of 3 x 2000 cum capacity for disposal to various users.</p>  <ul style="list-style-type: none"> SEIL has achieved 100% fly ash utilization by September 2019. Efforts are on to sustain the 100% utilization of Fly Ash and achieved the same during the period from April 2022 to September 2022. Bottom ash is being sold to Brick Manufacturers for free of cost. <p>SEIL has installed and commissioned Fly Ash classification unit of 5 Lakh Tonne per annum within the site for facilitating exports.</p> <p>SEIL is exporting fly ash to USA & Middle East.</p>
S. No.	Name of the Solid Waste	Quantity	Disposal											
1	Fly Ash	0.96 Million Tons/ Annum	To Cement / brick units											
2	Bottom Ash	0.24 Million Tons/ Annum	To cement, brick manufacturing units. Unutilized bottom ash to ash pond in slurry mode											
22.	<p>The industry shall relocate the CAAQM station provided at sea intake point to suitable location in consultation with RO: Nellore.</p>	<p>Complied.</p> <p>SEIL has provided 4 No's of Continuous AAQM stations to cover both upwind and downwind directions for all the seasons.</p> <p>The said condition was omitted in the CFO amendment order No: APPCB/ VJA/ NLR/ 930/ HO/ CFO/ 2019 issued dated 13.07.2019.</p>												

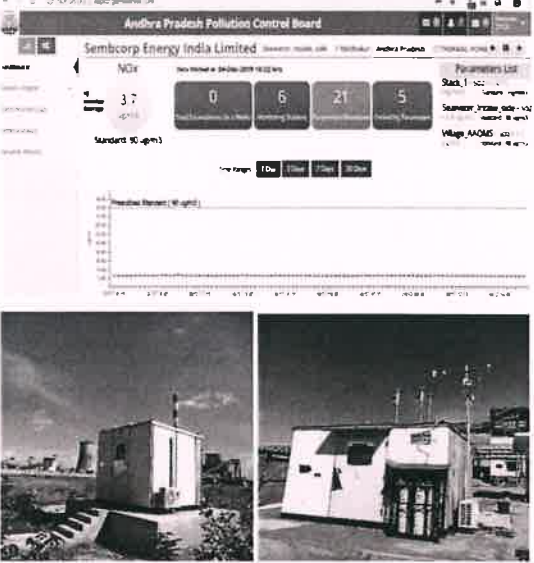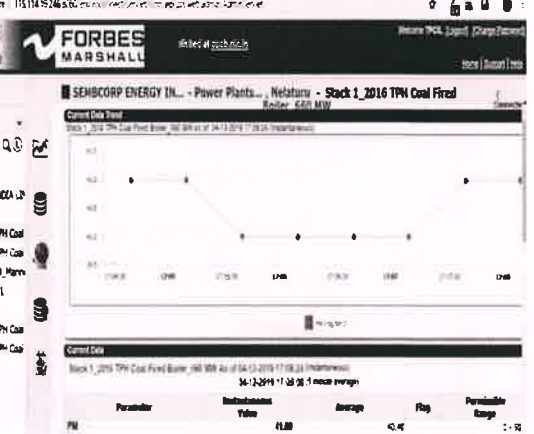


S. No.	Condition	Compliance Status
23.	<p>The industry shall operate CAAQM stations for monitoring SPM, SO₂, and NOx with recording facility and maintain connectivity to PCB server.</p>	<p>Complying.</p> <p>The Ambient Air Quality of the plant area and surroundings is being continuously monitored by using 4 No's of Continuous Air Quality Monitoring CAAQMS Stations. The data is being uploaded to PCB server on real-time basis.</p> 
24.	<p>The industry shall install online effluent and stack monitoring systems for specified parameters as per CPCB directions dated 05.02.2014 & 02.03.2015 and maintain connectivity to APPCB/CPCB websites.</p>	<p>SEIL has provided Online Stack Emission Monitoring system & Effluent Quality Monitoring system and same is connected with the APPCB/CPCB website.</p> 



M/s. Sembcorp Energy India Limited Project-1,
Painampuram & Nelaturu (V),
Muthukur (M),
SPSR Nellore (Dist.)

Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No.	Condition	Compliance Status
25.	The industry shall carryout regular calibration for the on-line stack monitoring systems and CAAQM stations with tamper proof mechanism.	Complying. Regular calibration of the CAAQMS system is being done. Also, the CEMS system has been provided with online Remote Calibration facility.
26.	The industry shall dispose 100% of fly ash generated as per the Fly ash Notification.	Complying. SEIL has attained 100% fly ash utilization by September 2019. SEIL is making all out efforts to sustain 100% utilization of fly ash and achieved the same. MoUs are signed with brick manufacturers, traders and cement plants for ash utilization. Dedicated Fly Ash Management Cell has been formed to have focused efforts and approach towards 100% of fly ash utilization.
27.	The industry shall develop the thick green belt in an area of 395 acres covering all along the periphery of the industry, coal stack yard and ash pond area.	Complying. Around 450 acres of green belt developed inside the plant and along the periphery of boundary. Own Nursery has been developed inside the plant premises. 



M/s. Sembcorp Energy India Limited Project-1,
Painampuram & Nelaturu (V),
Muthukur (M),
SPSR Nellore (Dist.)

Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021



S. No.	Condition	Compliance Status
28.	The industry shall submit a copy of policy of Public Liability Insurance (PLI) duly indicating the amount contributed towards Environmental Relief Fund (ERF) to the RO once in six months.	Complying. The copy of PLI is being submitted to APPCB Regional office on regular basis. (Policy Number: 03040058050200 Policy Effective from 19/11/2022 to 18/11/2023) PLI Policy attached as Annexure-V
29.	The industry shall comply with Board directions issued from time to time.	Noted.
30.	The industry shall comply with standards and directions issued by CPCB/MoEF&CC as and when notifications are issued.	Noted.
31.	The industry shall submit compliance report on the conditions mentioned in the consent order every six months i.e., on 1 st of January and July of every year to the RO/ ZO.	Complying. SEIL Project-1 (formerly known as Thermal Powertech corporation India Limited – TPCIL) has submitted the six-monthly CFO compliance report to APPCB vide letter No: SEIL P1/ APPCB/ BZA/2022/006 dated 27.06.2022.



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

Schedule-C		
S. No.	Condition	Compliance Status
1	The authorized person shall comply with the provisions of the Environment (Protection) Act, 1986, and the rules made there under.	Complying.
2.	The authorization shall be produced for inspection at the request of an officer authorized by the state Pollution Control Board.	Noted for Compliance.
3.	The person authorized shall not rent, lend, sell, transfer or otherwise transport the hazardous and other wastes except what is permitted through this authorisation.	Noted.
4.	Any unauthorized change in personnel, equipment or working conditions as mentioned in the application by the person authorised shall constitute a breach of his authorization.	Noted.
5.	The person authorised shall implement Emergency Response Procedure (ERP) for which this authorisation is being granted considering all site-specific possible scenarios such as spillages, leakages, fire etc. and their possible impacts and also carry out mock drill in this regard at regular interval of time.	Complying. Onsite Emergency Management Plan is in place to meet any eventuality. Periodic mock drills are being conducted.



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No.	Condition	Compliance Status
6.	The person authorised shall comply with the provisions outlined in the Central Pollution Control Board guidelines on "Implementing Liabilities for Environmental Damages due to Handling and Disposal of Hazardous Waste and Penalty".	Noted for Compliance.
7.	It is duty of the authorised person to take prior permission of the pollution Control Board to close down the facility.	Noted
8.	The hazardous and other waste which gets generated during recycling or reuse or recovery or pre-processing or utilization of imported hazardous or other wastes shall be treated and disposed of as per specific conditions of authorisation.	Complying. All the Hazardous Wastes generated are being disposed to authorized vendors through APEMC.
9.	An application for the renewal of an authorisation shall be made as laid down under these Rules.	Noted for Compliance.
10	Any other conditions for compliance as per the Guidelines issued by the Ministry of Environment, Forest and Climate Change or Central Pollution Control Board from time to time.	Noted for Compliance.
11.	Annual returns shall be filed by June 30 th for the period ensuring 31 st March of the year.	Complying. SEIL Project-1 has submitted the Hazardous Waste Annual returns in Form-4 to APPCB vide SEIL P1/APPCB/Nellore/2022/003 dated 25.06.2022.
12.	The industry shall not store hazardous waste for more than 90 days as per the Hazardous Wastes (Management & Transboundary Movement) Rules, 2016.	Complying. Disposal of Hazardous wastes being done through APEMC Authorized Waste Receivers as per HWM rules.



Order No. APPCB/VJA/NLR/930/HO/CFO/2016-, Date: 16.11.2021

S. No.	Condition	Compliance Status
13.	The industry shall store Used / Waste Oil and Used Lead Acid Batteries in a secured way in their premises till its disposal to the manufacturers / dealers on buyback basis.	Complying. SEIL Project-1 is storing the Used / Waste Oil and Used Lead Acid Batteries under a secured Hazardous Waste Storage shed and being disposed through APEMC to APPCB Authorized Receivers.
14.	The industry shall maintain 7 copy manifest system for transportation of waste generated and a copy shall be submitted to concern Regional Office of APPCB. The driver who transports Hazardous Waste should be well acquainted about the procedure to be followed in case of an emergency during transit. The transporter should carry a Transport Emergency (TREM) Card.	Complying. Hazardous wastes disposal is being done through APEMC online portal to authorized waste Receivers by following Manifest system as per HWM rules, 2016. Hazardous Waste Manifests are being submitted to RO, APPCB. TREM card is being issued to transporters during transportation.
15.	The industry shall maintain proper records for Hazardous and Other Wastes stated in Authorisation in Form-3 i.e., quantity of Incinerable waste, land disposal waste, recyclable waste etc., and file annual returns in Form- 4 as per Rule 20(2) of the Hazardous and Other Wastes (Management & Transboundary Movement) Rules, 2016.	Complying. SEIL Project-1 is maintaining Hazardous waste records in Form-3. SEIL Project-1 has submitted the Hazardous Waste Annual returns in Form-4 to APPCB vide SEIL P1/APPCB/Nellore/2022/003 dated 25.06.2022.

