

Forbes Marshall

Sembcorp Energy India Limited Project 2-old name Sembcorp Gayatri Power Ltd

Formerly M/s NCC Power Projects Limited & M/s Nelcast Energy Corporation Ltd
 Near Painapuram, Varakavipudi & Sivarampuram Village, Muthukur Mandal
 SPSR Nellore, SPS NELLORE, NELLORE. ANDHRA PRADESH - 524344

Station Report


Station: Stack1_2000TPH Boiler Unit 1

From : 01-07-2020 00:00:00

To : 31-07-2020 23:59:59

Interval : Daily

Function : Average

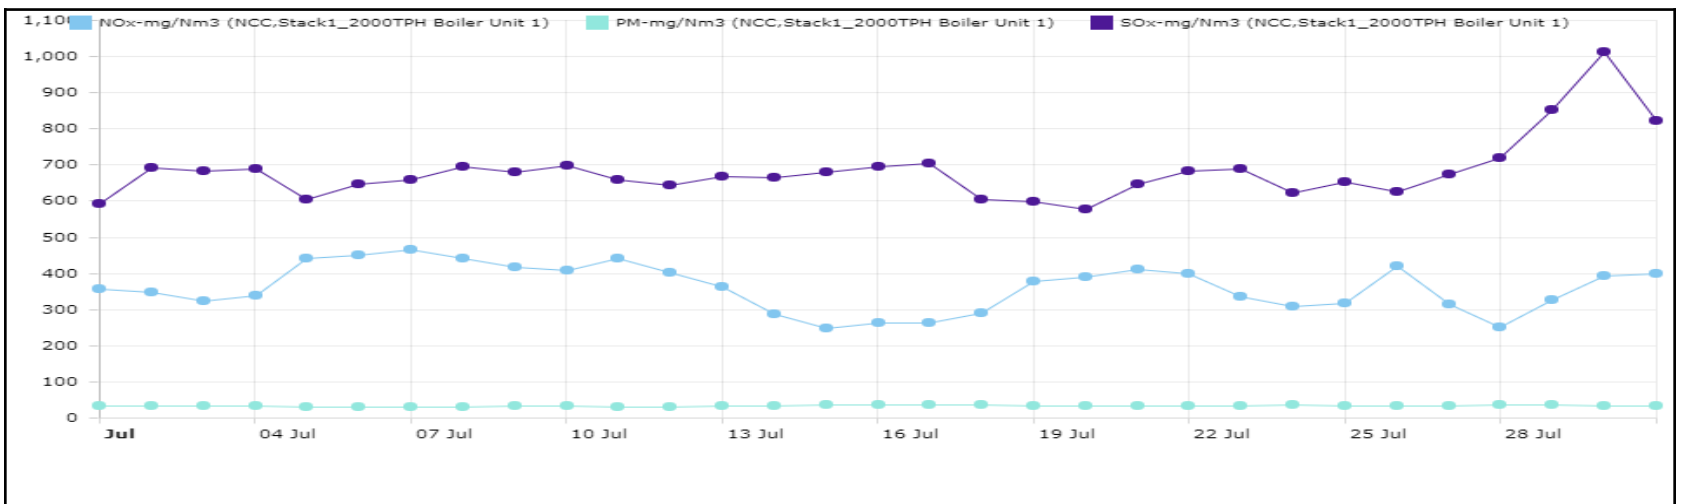

Flag legends: < - Average with less data, C - Calibration mode, M - Maintenance mode, S - Data under scrutiny, B - Bad data, H - High permissible limit crossed, L - Low permissible limit crossed, P - Processed Data, V - Corrected Data, D - Delayed Data, R - Analyzer drift

Calender	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
01-07-2020 00:00:00	357.07	31.92 H	592.63			
02-07-2020 00:00:00	346.28	32.30	693.06			
03-07-2020 00:00:00	324.58	32.33	683.12			
04-07-2020 00:00:00	338.61	32.73	687.51			
05-07-2020 00:00:00	442.64	31.26 H	605.08			

Calender	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
06-07-2020 00:00:00	451.76	31.20	645.49			
07-07-2020 00:00:00	466.59	31.34	658.60			
08-07-2020 00:00:00	440.26	31.52	695.60			
09-07-2020 00:00:00	417.43	31.83	678.67			
10-07-2020 00:00:00	407.57	32.02	699.30			
11-07-2020 00:00:00	440.75	31.59	658.50			
12-07-2020 00:00:00	400.54	31.16	644.15			
13-07-2020 00:00:00	361.14	31.90	667.24			
14-07-2020 00:00:00	287.35	33.06	664.23			
15-07-2020 00:00:00	248.36	34.79	679.35			
16-07-2020 00:00:00	262.67	34.77	694.58			
17-07-2020 00:00:00	263.15	34.82	703.68			
18-07-2020 00:00:00	290.63	35.09	603.26			
19-07-2020 00:00:00	377.72	32.69	599.60			
20-07-2020 00:00:00	388.87	32.60	576.57			
21-07-2020 00:00:00	410.89	31.80	646.58			
22-07-2020 00:00:00	399.91	32.70	682.42			
23-07-2020 00:00:00	334.01	33.83	687.66			
24-07-2020 00:00:00	306.80	35.09	623.13			
25-07-2020 00:00:00	317.10	34.22	652.35			
26-07-2020 00:00:00	418.89	32.13	625.39			
27-07-2020 00:00:00	315.31	33.93	672.97			

Calendar	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
28-07-2020 00:00:00	251.42	35.29	719.72			
29-07-2020 00:00:00	326.12	35.37	851.02			
30-07-2020 00:00:00	391.99	34.19	1011.37			
31-07-2020 00:00:00	399.08	34.53	820.52			

Report Summary

Average	360.82	33.03	681.40			
Maximum	466.59	35.37	1011.37			
Minimum	248.36	31.16	576.57			
Std.Deviation	63.69	1.42	83.72			
Geom.Mean	355.13	33.00	677.10			
Median	361.14	32.69	672.97			
Mode	361.14	31.59	687.66			
Total Active Duration						

Forbes Marshall

Semcorp Energy India Limited Project 2-old name Semcorp Gayatri Power Ltd

Formerly M/s NCC Power Projects Limited & M/s Nelcast Energy Corporation Ltd
 Near Painapuram, Varakavipudi & Sivarampuram Village, Muthukur Mandal
 SPSR Nellore, SPS NELLORE, NELLORE. ANDHRA PRADESH - 524344

Station Report


Station: Stack2_2000TPH Boiler TPPs Unit 2

From : 01-07-2020 00:00:00

To : 31-07-2020 23:59:59

Interval : Daily

Function : Average

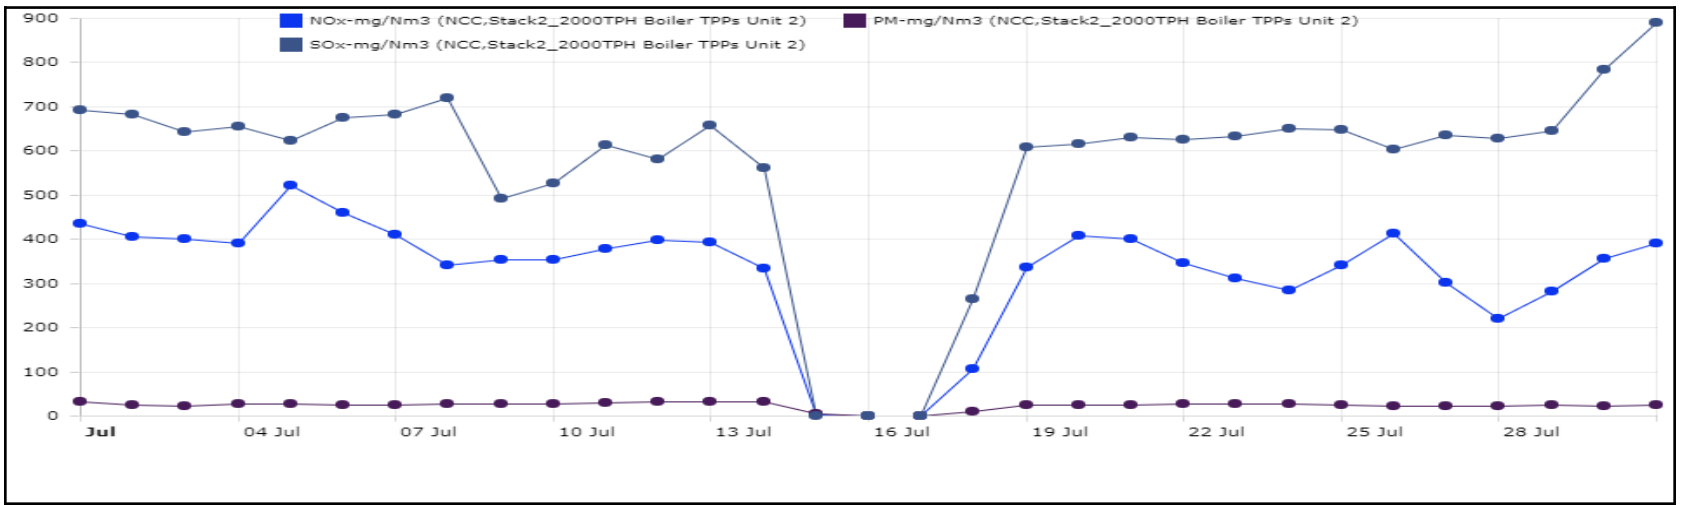

Flag legends: < - Average with less data, C - Calibration mode, M - Maintenance mode, S - Data under scrutiny, B - Bad data, H - High permissible limit crossed, L - Low permissible limit crossed, P - Processed Data, V - Corrected Data, D - Delayed Data, R - Analyzer drift

Calender	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
01-07-2020 00:00:00	436.07	32.83 HSB	691.97			
02-07-2020 00:00:00	406.05	25.94	683.16			
03-07-2020 00:00:00	401.75	22.53 H	642.47			
04-07-2020 00:00:00	391.05	26.11	654.09			
05-07-2020 00:00:00	521.97	26.76	623.89			

Calender	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
06-07-2020 00:00:00	460.03	25.23	674.60			
07-07-2020 00:00:00	409.32	25.18	681.93			
08-07-2020 00:00:00	341.92	26.33	718.95			
09-07-2020 00:00:00	354.69	27.27 H	491.75			
10-07-2020 00:00:00	353.96	28.07	526.86			
11-07-2020 00:00:00	377.30	29.15 H	612.74			
12-07-2020 00:00:00	397.57	31.68	580.41			
13-07-2020 00:00:00	392.92	30.98	657.95			
14-07-2020 00:00:00	333.11	32.46 HS	562.42			
15-07-2020 00:00:00	2.71	4.82 S	0.10			
16-07-2020 00:00:00	0.00	0.06	0.01			
17-07-2020 00:00:00	0.00	0.01	0.00			
18-07-2020 00:00:00	106.74	10.41 HS	264.97			
19-07-2020 00:00:00	335.27	24.42	607.38			
20-07-2020 00:00:00	408.44	25.64	615.36			
21-07-2020 00:00:00	399.58	25.55	629.46			
22-07-2020 00:00:00	345.02	26.18	625.76			
23-07-2020 00:00:00	312.22	27.75	631.82			
24-07-2020 00:00:00	284.61	26.83	651.51			
25-07-2020 00:00:00	341.24	25.81	648.63			
26-07-2020 00:00:00	414.07	22.47	604.10			
27-07-2020 00:00:00	302.34	21.17	634.44			

Calender	NOx Avg	PM Avg	SOx Avg			
Units	mg/Nm3	mg/Nm3	mg/Nm3			
Range		0 - 50				
28-07-2020 00:00:00	221.04	22.05	627.16			
29-07-2020 00:00:00	280.86	25.47	645.21			
30-07-2020 00:00:00	356.44	23.27 H	784.94			
31-07-2020 00:00:00	390.60	23.63	889.36			

Report Summary

Average	325.13	23.42	569.79			
Maximum	521.97	32.83	889.36			
Minimum	0.00	0.01	0.00			
Std.Deviation	130.68	8.33	213.16			
Geom.Mean	191.46	15.15	216.38			
Median	354.69	25.64	629.46			
Mode	392.92	4.82	645.21			
Total Active Duration						